

CASE STUDY

The Pyplok logo features the word "Pyplok" in a white, sans-serif font. The letter "o" is replaced by a green circular icon with a white grid pattern. A registered trademark symbol (®) is located to the upper right of the "k".The Equinor logo consists of the word "equinor" in a red, lowercase, sans-serif font. To the right of the text is a red graphic element composed of four stylized, overlapping leaf-like shapes that form a cross-like pattern.

INSTALLATION DATE:

August 2022

END USER:

Equinor – Oseberg C Platform
All delivery of parts and supervising of installation
done by Hydra Pipe AS

LOCATION:

Oseberg Field Centre, Norway North Sea

LINES SIZES AND MATERIAL:



Multiple sizes 25mm - 76mm, elbows,
tees, flanges
CuNi (Copper Nickel)

SYSTEM MEDIUM:

Fire Extinguishing System

SPECIAL COMMENTS OR NOTES:

Equinor had a major challenge with the fire extinguishing system at Oseberg C, which was in poor condition and had to be renovated. All 10 floors of the housing module were to be reviewed and renovated. This was a particularly difficult task as the housing module is in use 24 hours a day, all year round. During the project, approx. 3,000 Pyplok® fittings in dimensions 25mm, 30mm, 44mm, 57mm, and 76mm, in many varieties such as straight joints, 45-degree and 90-degree elbows, 150# and 300# ANSI flanges, tees in several designs and Pyplok® special coupling to screw in the fire nozzle. Ceilings were taken down, pipes were cut, new ones were adapted and swaged on before the ceiling was fitted back in place - all while the installation was otherwise in full operation.

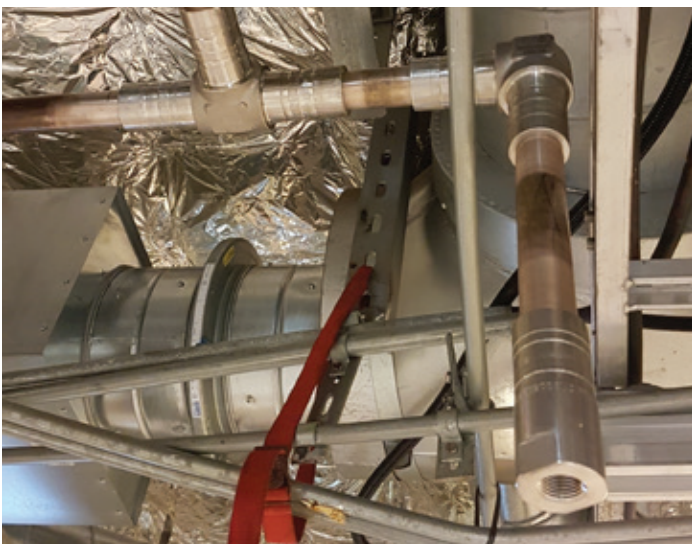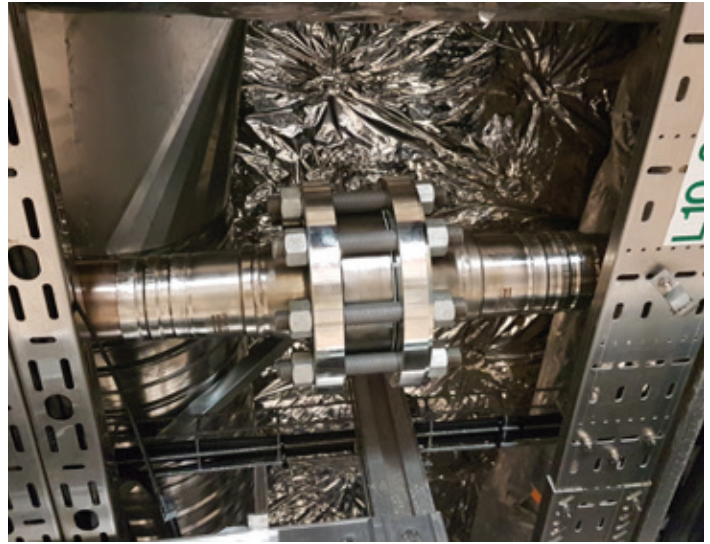



Pyplok[®]

pyplok.com



100%
lekkasjesikker
remontering

Ta ansvar for
hver dråpe olje

Hydra Pipe AS
Sjukenesstranda 41 B
6037 Eidsnes
NORWAY

+47 70 17 72 00